


# Executive Order G-70-150-AE

## Exhibit 2

**Figure 2A-3**

Typical Installation of the  
MCS VaporVac Phase II Vapor Recovery System  
with Two-Point Phase I System

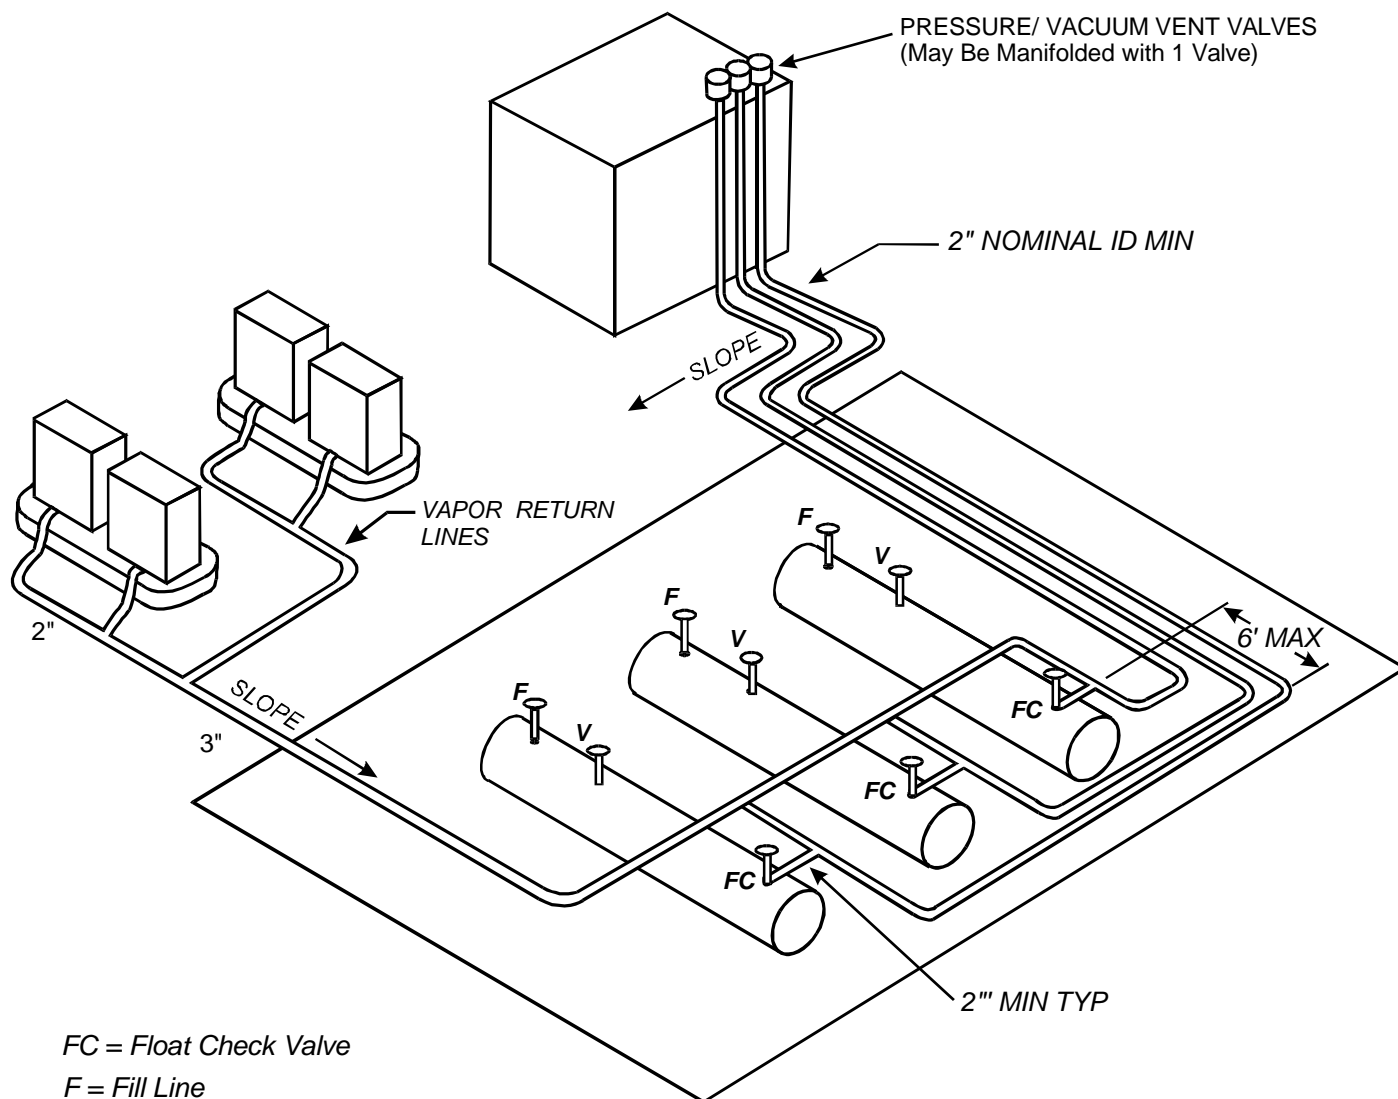

FC = Float Check Valve

F = Fill Line

V = Phase I Vapor Recovery

Note: 1. All Vapor/Vent Lines are 3" Nominal ID Minimum Except as Noted

2. Slope: 1/8" per foot Min.

1/4" per Foot Preferred

3. Maintain 2'0" Clearance Between Fill Line and  
Phase I Vapor Return Line to Delivery Truck